

Extintor de fuego a riel DIN

El Extinguidor Automático por Aerosol Tipo S ofrece una protección eficiente y confiable para tableros eléctricos, actuando de forma rápida ante incendios en su etapa inicial. Su diseño compacto tipo riel DIN permite integrarlo fácilmente dentro del tablero, sin instalaciones complejas ni sistemas presurizados.


Gracias a su avanzada tecnología de aerosol, el dispositivo enfía e inhibe químicamente el fuego, logrando una extinción eficaz sin dañar equipos sensibles. Es una solución segura, libre de toxicidad y de bajo impacto ambiental, ideal para tableros eléctricos, gabinetes de control y espacios eléctricos reducidos. No requiere conexionado eléctrico, no necesita recarga de gas.




Características técnicas

Modelo	YCFP7-D0.01G/S-QR
Clasificación	Tipo S
Cantidad de agente extintor	10g
T° de funcionamiento	-50°C~90°C
Espacio protegido	0,1m ³ (Equivalente a un gabinete de 1000x500x200mm)
Composición	60% Sr(NO ₃) ₂ / 20% KNO ₃
Distancia mínima de seguridad	0,3m ≤ 75 °C; 0,12m ≤ 200 °C; 0,05m ≤ 400 °C
Montaje	Con adhesivo o riel Din
Vida útil	10 años
Estandar	EN 15276-1 / EN 15276-2

Dimensiones

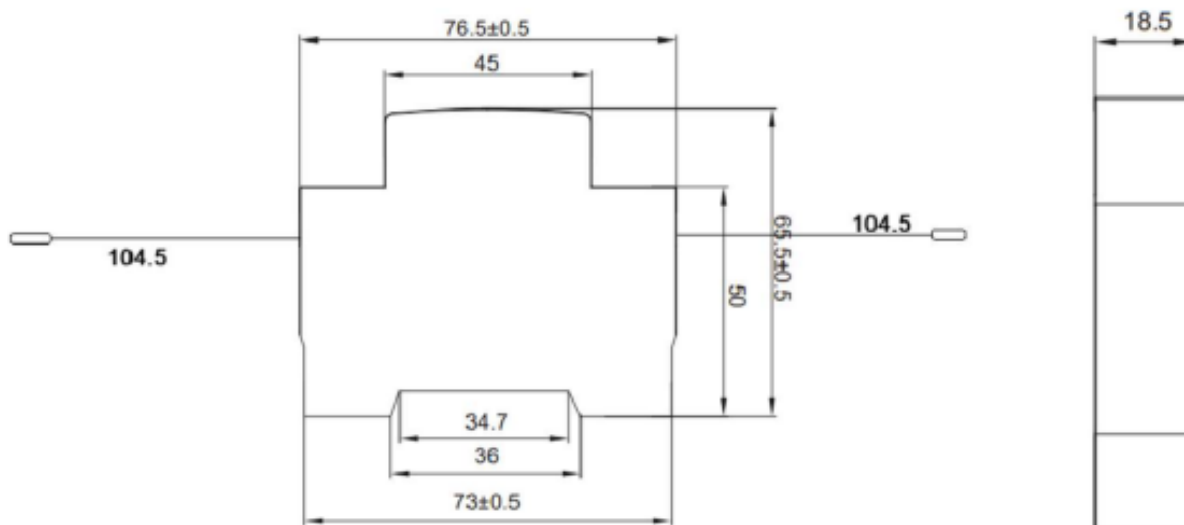

Identificación de componentes y características generales

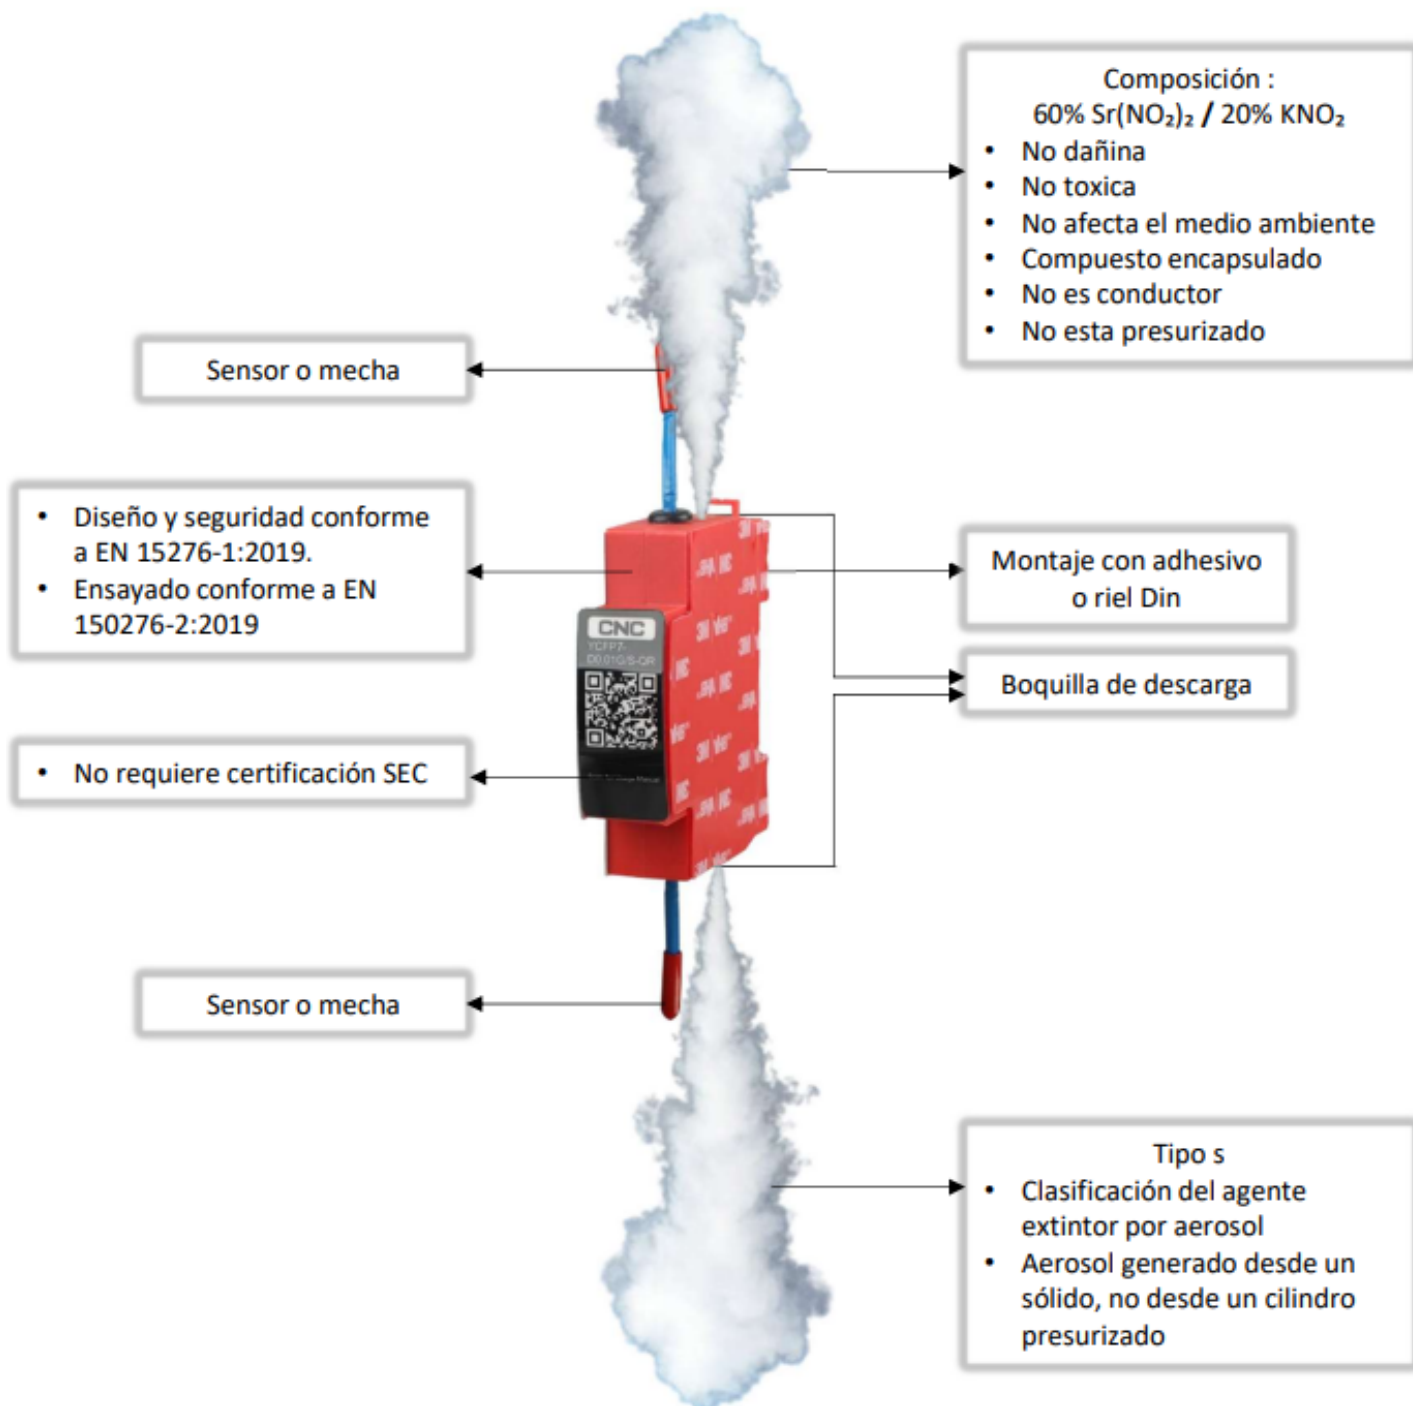

De acuerdo con antecedentes publicados por el **Cuerpo de Bomberos de Chile**, aproximadamente el **40 % de los incendios estructurales en el país se originan por fallas o problemas eléctricos**, lo que refuerza la necesidad de implementar sistemas de detección y extinción temprana en instalaciones eléctricas e industriales.

Fuente: Cuerpo de Bomberos de Chile



S/N: 018412

VERIFICATION OF CONFORMITY

No.: **ICR/VC/HS251134**

Name and address of Applicant

Zhejiang Changcheng Trading Co., Ltd.
No. 66, Huachi Road, Yanjiang Industrial Area, BeiBaixiang Town,
Yueqing City, Wenzhou City, 325603, Zhejiang Province, China

Name and address of manufacturer:

CNC Electric Group Co., Ltd.
No. 66, Huachi Road, Yanjiang Industrial Area, BeiBaixiang Town,
Yueqing City, Wenzhou City, 325603, Zhejiang Province, China

Product name:

Hot aerosol fire extinguishing device

Product types:

YCFP7-D0.01G/S-QR, YCFP7-D0.012G/S-QR, YCFP7-D0.02G/S-QR,
YCFP7-D0.03G/S-QR, YCFP7-D0.04G/S-QR, YCFP7-D0.05G/S-QR,
YCFP7-D0.06G/S-QR, YCFP7-D0.075G/S-QR, YCFP7-D0.09G/S-QR,
YCFP7-D0.1G/S-QR, YCFP7-D0.15G/S-QR, YCFP7-D0.2G/S-QR,
YCFP7-D0.25G/S-QR, YCFP7-D0.3G/S-QR, YCFP7-D0.4G/S-QR,
YCFP7-D0.5G/S-QR, YCFP7-D0.8G/S-QR, YCFP7-D1G/S-QR,
YCFP7-D1.5G/S-QR, YCFP7-D2G/S-QR, YCFP7-D3G/S-QR

Product trademark:

CNC

Verification was carried within following scope:

Information on the Declaration of Conformity:

Result:	Legislation:	Standard:
✓	PED [2014/68/EU]	EN 15276-1:2019 EN 15276-2:2019

The assessment process has been carried out in accordance with individual rules and conditions agreed with the applicant.
Evaluation has been carried out in accordance with:

Test report:	HAFTCF1106-PED
Tests conducted by:	Zhejiang Changcheng Trading Co., Ltd.
Issue date:	07.11.2025
Expiration date:	06.11.2030

Remarks:

- VoC was issued on voluntary basis and does not imply meeting all essential requirements listed in Declaration of Conformity.
- For introducing this product on European market may be needed EC/EU-type examination conducted by appropriate Notified Body.

ICR Co. Ltd.
www.icrqa.com
www.icrpolska.com
cert@icrqa.com



CEO, ICR Co., Ltd.



Edition: 5.1.1.8 of 06.03.2024



+56 9 5513 1741



ferrelectrica.cl



/ferrelectrica.cl



Av. Francisco Bilbao 706, Providencia